

Technical Sheet For EIB/KNX Switch Actuator

LMR0416

LMR0816

LMR1216



The worldwide STANDARD for home and building control


CHARACTERISTICS

- Manual operation available
- Time functions, on/off delay
- Scene control / presets via 8bit/1bit commands
- Logic operation AND, OR, XOR, gate function
- Status response
- Forced operation and safety function
- Reaction to threshold functions
- Control of electro thermal valve drives
- Selection of preferred state after bus voltage failure and recovery
- Inversion of the outputs
- Staircase lighting functions with warning and adaptable staircase lighting time.

PARAMETERS


Power Supply	Operation voltage	21~30V DC, via the EIB bus
	Current consumption	<12mA
	Power consumption	Max.360mW
Output	Number of contacts	4/8/12
	U _n rated voltage	250/440V AC (50/60 HZ)
	I _n rated current	16A
	Max. leakage loss	2W/4W/8W
Operation and display	Red LED and push button	For assigning the physical address
	Green LED flashing	For display the application layer running normally
	Stand-alone operation	Via local operation, extension inputs
	Indication of the contact position	Close means the output is on Open means the output is off
Connections	EIB/KNX	Bus connection terminal (black/red)
	Load circuits	Screw terminals
Temperature	Operation	-5°C~45°C
	Storage	-25°C~55°C
	Transport	-25°C~70°C
Mounting	On 35mm mounting rail	
CE norm	According to the EMC and low voltage guideline	
Certification	EIB/KNX certified	

DIMENSIONS

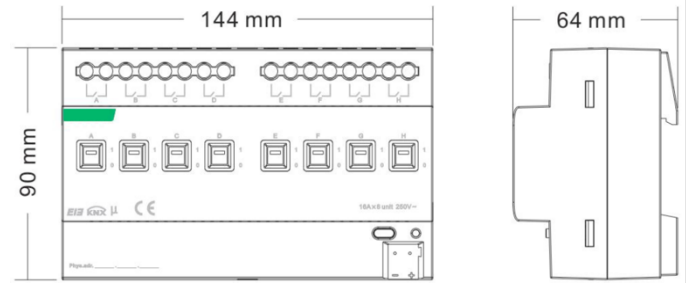

Model	Dimension	Weight
LMR0416	72 x 90 x 64mm	0.3kg
LMR0816	144 x 90 x 64mm	0.5kg
LMR01216	216 x 90 x 64mm	0.75kg

DESCRIPTIONS

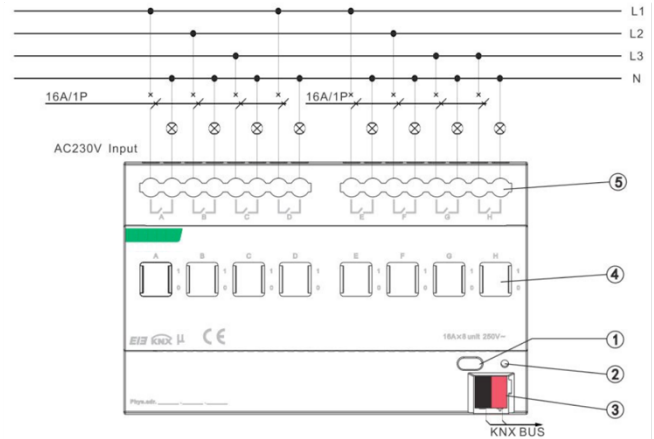

- 1 Programming button
- 2 Red LED for entering the physical address, green LED for application process normally running
- 3 EIB/KNX bus connection terminal
- 4 Manual operation switch control
- 5 Output, load terminal

INSTALLATION FIGURE

The devices are suitable for installation on the distribution boards with 35mm mounting rail which complies with DIN EN 60715 or a small box in order to facilitate quick installation of the device. Must ensure that the device operation, testing, detecting, maintenance correctly.

IMPORTANT INFORMATION

Installation and commissioning of the device may only be carried out by trained electricians. The relevant standards, directives, regulations and instructions must be observed when planning and implementing the electrical installation.

- Protect the device against moisture, dirt and damage during transport, storage and operation!
- Do not operate the device outside the specified technical data (e.g. temperature range)!
- The device may only be operated in closed enclosures (e.g. distribution boards).

Should the device become soiled, it may be cleaned with a dry cloth. If this does not suffice, a cloth lightly moistened with soap solution may be used. On no account should caustic agents or solvents be used.